

TEST REPORT

AAMA/WDMA/CSA 101/I.S.2/A440-11

REPORT NO.: 1931.04-106-11

RENDERED TO: GAMCO CORPORATION
Flushing, New York

PRODUCT TYPE: Aluminum Outswing Twin Casement Window

SERIES / MODEL: W250HC

Test	Summary of Results
Primary Product Designator	Class AW – PG40 1829 x 1524 (72 x 60)-C
Design Pressure	±1920 Pa (±40.10 psf)
Air Infiltration at 300 Pa (6.24 psf)	0.3 L/s/m ² (0.06 cfm/ft ²)
Air Exfiltration at 75 Pa (1.57 psf)	0.2 L/s/m ² (0.04 cfm/ft ²)
Water Penetration Resistance Test Pressure	440 Pa (9.19 psf)

Test Completion Date: 6/20/2019

Reference must be made to Report No. 1931.04-106-11, dated 8/23/2019 for complete test specimen description and detailed test results.

CLIENT INFORMATION: GAMCO CORPORATION
131-10 Maple Ave.
Flushing, New York 11355

TEST LABORATORY: Molimo, LLC
1410 Eden Road
York, Pennsylvania 17402
717-900-6034

PROJECT SUMMARY:

PRODUCT TYPE: Aluminum Outswing Twin Casement Window

SERIES/MODEL: W250HC

PROJECT SUMMARY:

Molimo, LLC was contracted to perform testing on the above referenced product. The results are tested values and were secured by using the designated test methods. A summary of the ratings achieved for the specimen tested are shown in the table below.

SPECIMEN	SPECIFICATION	PRODUCT RATING
1	101/I.S.2/A440-11	Class AW – PG40 1829 x 1524 (72 x 60)-C

PROJECT DETAILS:

Test Dates: 5/14/2019 – 6/20/2019

Test Record Retention End Date: 6/20/2023

Test Location: Molimo, LLC test facility in York, Pennsylvania.

Test Specimen Source: The test specimen was provided by the client. Representative samples of the test specimen will be retained by Molimo for a minimum of four years from the test completion date.

Drawing Reference: The test specimen drawings were supplied by the client. The test specimen construction was verified by Molimo and was found to be representative of the product tested. Test specimen drawings are located in Appendix C of this report.

WITNESSES:

The following representatives witnessed all or part of the testing.

Name	Company
Joe Allison	Molimo, LLC
Michael D. Stremmel, P.E.	Molimo, LLC
Joseph Enriquez	Molimo, LLC

TEST METHODS:

AAMA/WDMA/CSA 101/I.S.2/A440-11, *NAFS 2011 - North American Fenestration Standard/Specification for Windows, Doors, and Skylights*

AAMA 910-10, *Voluntary "Life Cycle" Specifications and Test Methods for AW Class Architectural Windows and Doors*

TEST SPECIMEN DESCRIPTION:**PRODUCT SIZES:**

Overall Size:	1829 mm x 1524 mm (72" x 60")
Overall Area:	2.7 m ² (30.0 ft ²)
Vent Size (2):	892 mm x 1325.5 mm (35-1/8" x 52-3/16")

FRAME CONSTRUCTION:

Material:	Poured and debridged, thermally improved, extruded aluminum
Corner Details:	Coped and butted, sealed with sealant and secured with four #8 x 2" pan head screws per corner
Other Details:	The fixed astragal was coped and butted, sealed with sealant and secured with two #8 x 2" pan head screws per end

VENT CONSTRUCTION:

Material:	Poured and debridged, thermally improved, extruded aluminum
Corner Details:	Miter-cut, sealed with sealant and secured with two internal aluminum corner keys with one lanced stack per member end

REINFORCEMENT: No reinforcement was utilized.

TEST SPECIMEN DESCRIPTION: (Continued)

GLAZING DETAILS: *No conclusions of any kind regarding the adequacy or inadequacy of the glass in any glazed test specimen can be made.*

Description	Detail
Glass Type	1" IG
Glazing Construction (exterior to interior)	1/8" thick tempered glass 3/4" desiccant filled, aluminum box type spacer 1/8" thick tempered glass
Glazing Method	Set from the interior against a bead of sealant and secured with aluminum snap-fit glazing beads with a gasket against the glass
Glazing Bite	1/2"
Daylight Opening Vent (2):	752 mm x 1313 mm (29-5/8" x 51-11/16")

WEATHERSTRIPPING:

Description	Quantity	Location
3/16" diameter foam-filled vinyl bulb	1 Row	Frame and vent perimeters

DRAINAGE: No drainage was utilized.

HARDWARE:

Description	Quantity	Location
Barrel hinges	3 per vent	Hinge jambs, 4" from each end and midspan
Rotary operator	1 per vent	Sill, 5-1/2" from the hinge jamb
Multi-point lock	1 per vent	Vent lock stile, handle located 12" from the sill with two lock points located 10-1/2" from each end of the lock stile

TEST SPECIMEN DESCRIPTION: (Continued)

INSTALLATION: The specimen was installed into a Spruce-Pine-Fir wood buck. The rough opening allowed for a 1/2" shim space. The exterior perimeter of the specimen was sealed with sealant.

Location	Anchor Description	Anchor Spacing
Head and sill	#8 x 3" wood screw	5" from each end and spaced 16" on center, through the frame into the wood buck
Jambs	#8 x 3" wood screw	5" from each end and spaced 16" on center, through the frame into the wood buck

TEST RESULTS: The temperature during testing was 21.7 °C (71 °F).

OPERATING FORCE: First Half (per ASTM E 2068)

Test	Results	Allowable
Initiate Motion	22 N (5 lbf)	70 N (15 lbf)
Maintain Motion (Opening)	22 N (5 lbf)	45 N (10 lbf)
Maintain Motion (Closing)	22 N (5 lbf)	45 N (10 lbf)
Locks / Latches	22 N (5 lbf)	100 N (22.5 lbf)

Note #1: The operating force results listed above represent the maximum force measured among all sash tested.

AIR LEAKAGE TESTING: First Half (per ASTM E 283)

Test	Results	Allowable
Infiltration @ 300 Pa (6.24 psf)	0.3 L/s/m ² (0.06 cfm/ft ²)	0.5 L/s/m ² (0.10 cfm/ft ²)
Exfiltration @ 75 Pa (1.57 psf)	0.2 L/s/m ² (0.04 cfm/ft ²)	0.5 L/s/m ² (0.10 cfm/ft ²)

Note #2: The specimen tested meets (or exceeds) the performance levels specified in AAMA/WDMA/CSA 101/I.S.2/A440 for air leakage resistance.

TEST RESULTS: (Continued)

WATER PENETRATION TESTING: First Half (per ASTM E 331 and ASTM E 547)

Test	Results	Allowable
440 Pa (9.19 psf)	Pass	No Leakage

Note #3: Water Penetration testing was performed without an insect screen.

VENT CYCLE TESTING:

Test	Results	Allowable
Vent Cycling 2000 cycles (first half)	Pass	No Damage
Misuse Testing per AAMA 910	Pass	No Damage
Vent Cycling 2000 cycles (second half)	Pass	No Damage

Observations: Normal signs of wear was visible on the locks after cycling.

OPERATING FORCE: Second Half (per ASTM E 2068)

Test	Results	Allowable
Initiate Motion	22 N (5 lbf)	70 N (15 lbf)
Maintain Motion (Opening)	22 N (5 lbf)	45 N (10 lbf)
Maintain Motion (Closing)	22 N (5 lbf)	45 N (10 lbf)
Locks / Latches	22 N (5 lbf)	100 N (22.5 lbf)

Note #4: The operating force results listed above represent the maximum force measured among all sash tested.

THERMAL CYCLING: (per AAMA 501.5)

Test	Results	Allowable
6 cycles (0° F to 180° F)	No Damage	No Damage

TEST RESULTS: (Continued)

UNIFORM LOAD TESTING: (per ASTM E 330)

Design Pressure Test	Results	Allowable
Deflection measured at the lock stile		
+1920 Pa (+40.10 psf)	1.5 mm (0.06")	5.0 mm (0.20")
-1920 Pa (-40.10 psf)	0.5 mm (0.02")	5.0 mm (0.20")

Note #5: All loads were held for 10 seconds.

Note #6: Tape and film were used to seal against air leakage. In our opinion, the tape and film did not influence the results of the test.

AIR LEAKAGE TESTING: Second Half (per ASTM E 283)

Test	Results	Allowable
Infiltration @ 300 Pa (6.24 psf)	0.1 L/s/m ² (0.02 cfm/ft ²)	0.5 L/s/m ² (0.10 cfm/ft ²)
Exfiltration @ 75 Pa (1.57 psf)	0.7 L/s/m ² (0.14 cfm/ft ²)	1.5 L/s/m ² (0.30 cfm/ft ²)

Note #7: The specimen tested meets (or exceeds) the performance levels specified in AAMA/WDMA/CSA 101/I.S.2/A440 for air leakage resistance.

WATER PENETRATION TESTING: Second Half (per ASTM E 331 and ASTM E 547)

Test	Results	Allowable
440 Pa (9.19 psf)	Pass	No Leakage

Note #8: Water Penetration testing was performed without an insect screen.

UNIFORM LOAD TESTING: (per ASTM E 330)

Structural Test	Results	Allowable
Permanent Set measured at the lock stile		
+2880 Pa (+60.10 psf)	1.2 mm (0.05")	1.8 mm (0.07")
-2880 Pa (-60.10 psf)	1.2 mm (0.05")	1.8 mm (0.07")

Note #9: All loads were held for 10 seconds.

Note #10: Tape and film were used to seal against air leakage. In our opinion, the tape and film did not influence the results of the test.

TEST RESULTS: (Continued)**SECONDARY TESTING:**

Test	Results	Allowable
FORCED ENTRY RESISTANCE per ASTM F 588 Type: B – Grade: 10	Pass	No Entry
SASH/LEAF TORSION 90 N (20 lbf)	57.2 mm (2.25")	65.8 mm (2.59")
SASH VERTICAL DEFLECTION 270 N (60 lbf)	13.2 mm (0.52")	17.5 mm (0.69")
SASH HARDWARE LOAD TEST 300 Pa (6.27 psf)	Pass	No Damage

General Note: All testing was performed in accordance with reference test methods.

A copy of this report, detailed drawings, datasheets, representative samples of test specimens, or other pertinent project documentation will be retained by Molimo, LLC for the entire test record retention period. At the end of this retention period, the service life of this report will expire.

Results obtained are tested values and were secured by using the designated test methods. This test report does not constitute certification of this product nor an opinion or endorsement by this laboratory. It is the exclusive property of the client so named herein and relates only to the specimen(s) tested. This report may not be reproduced, except in full, without the written permission of Molimo, LLC.

For MOLIMO, LLC:

Joseph W. Enriquez
Project Manager

Michael D. Stremmel, P.E.
Senior Project Engineer

MDS:jld

Attachments (pages): This report is complete only when all attachments listed are included.

Appendix-A: Alteration Addendum (1)

Appendix-B: Air Seal Location (1)

Appendix-C: Drawings (8)

This report was produced from controlled document template MMO 00013, Rev 2, 8/28/2018.

Appendix A

Alteration Addendum

Alteration #1


Date: 5/24/2019

Reason: Failed Air Leakage testing after thermal cycling and design loads

Remedial Work: Sealed the exterior weep holes and continued the testing with no weep holes

Appendix B


Air Seal Location

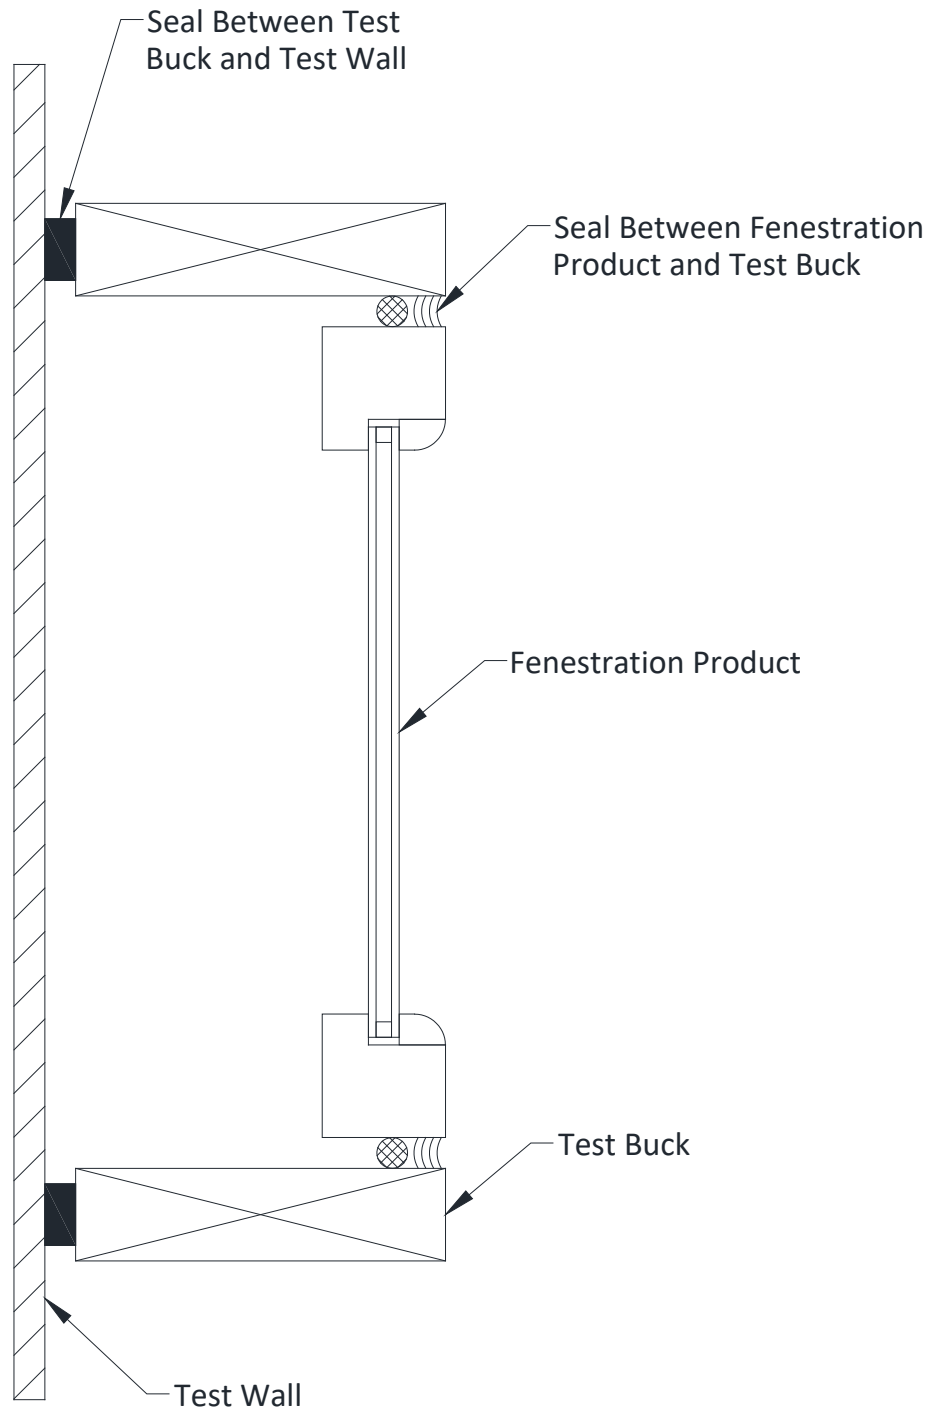


Appendix C

Drawings

BOM: W250HC-SWING-OUT TWIN-CASEMENT			
ITEM	DESCRIPTION	PART NO.	QTY.
1	250C/HC Window Head/Sill	H-16980	2
2	250HC Main Frame	H-2656	2
3	250HC Project-out	H-2660	8
4	250 Corner Key	S-13020	16
5	250 1" Glazing Bead	S-13014	8
6	Casement Hinge, Stainless Steel	WH1H4395	6
7	Casement Cam Lock	WH2L241G	2
8	Casement Lock Handle	WH2L242G	2
9	Lock Keeper	WH7K2108	4
10	Casement Stainless track	WH7T1325	2
11	Crank/Knob Handle	WH7H105G	2
12	Rotary Operatoer 13.5" right hand	WH3R348G	2
13	Setting Block	WH6N582	4
14	Butyl Tape for 1" I.G.	WH5G3654	8
15	Rubber Apply for 1" I.G.	WH6U3175	8
16	T-slot Bulb Seal Rubber	WH5T175B	16
17	Insulated Glass 1"	1/8" x 1/8"	-
18	Locking Block	WH7B2011	2
19	Anti-Drop	WH7B1630	2
20	250 Muntin	H-2652	1

 Molimo™ Architectural Product Testing	
Report #:	1931.04-106-11
Date:	8/23/2019
By:	M. Stremmel

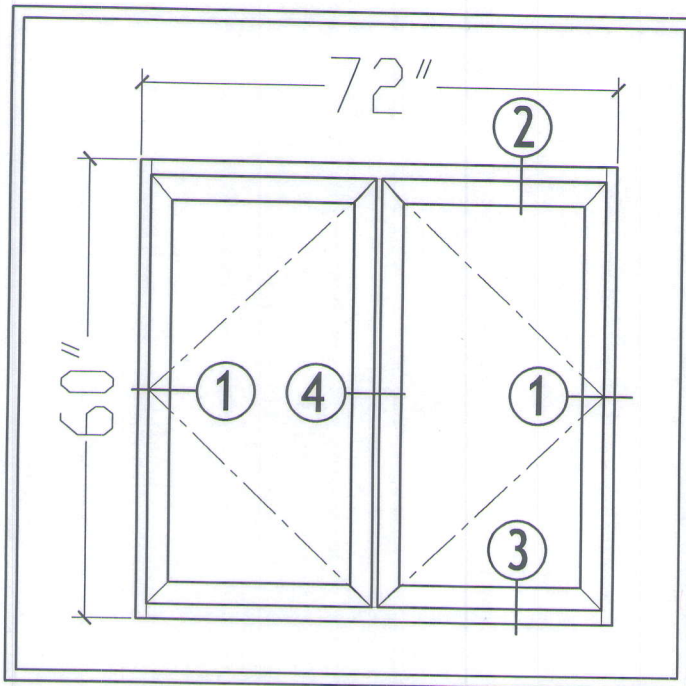

W250HC SERIES WINDOW SWING-OUT TWIN CASEMENT





Molimo™
Architectural Product Testing

Report #: 1931.04-106-11

Date: 8/23/2019

By: M. Stremmel

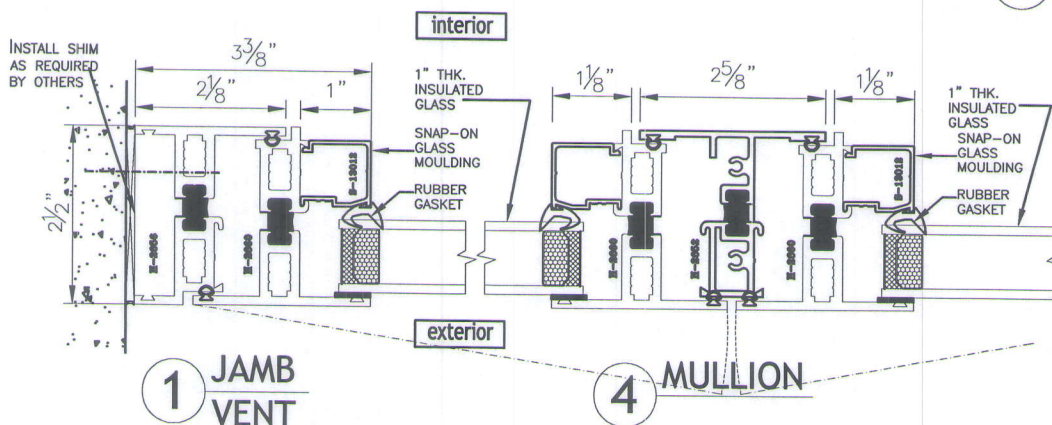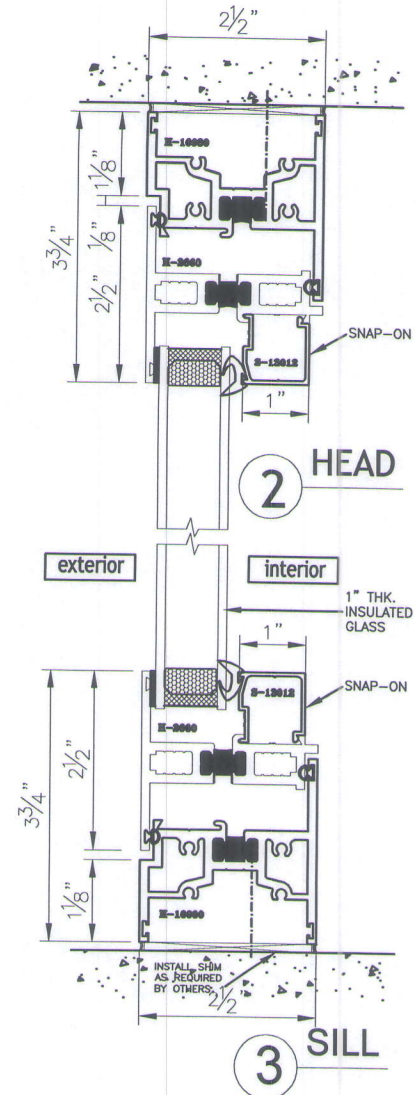

SHEET #

2B

Drawn by: C. CHAN

Checked by:

Date: 6-2-16

Scale: 3/4"=1'-0"

Customer

Project: W250HC
TWIN CASEMENT
WINDOW

Revisions

No.	Date	Description
01	10-29-18	NEW SILL & HEAD




GAMCO CORPORATION

MANUFACTURERS OF FENESTRATION PRODUCTS

131-10 MAPLE AVE. FLUSHING, N.Y. 11355

TEL: (718) 359-8833 FAX: (718) 359-8861

info@gamcocorp.com www.gamcocorp.com

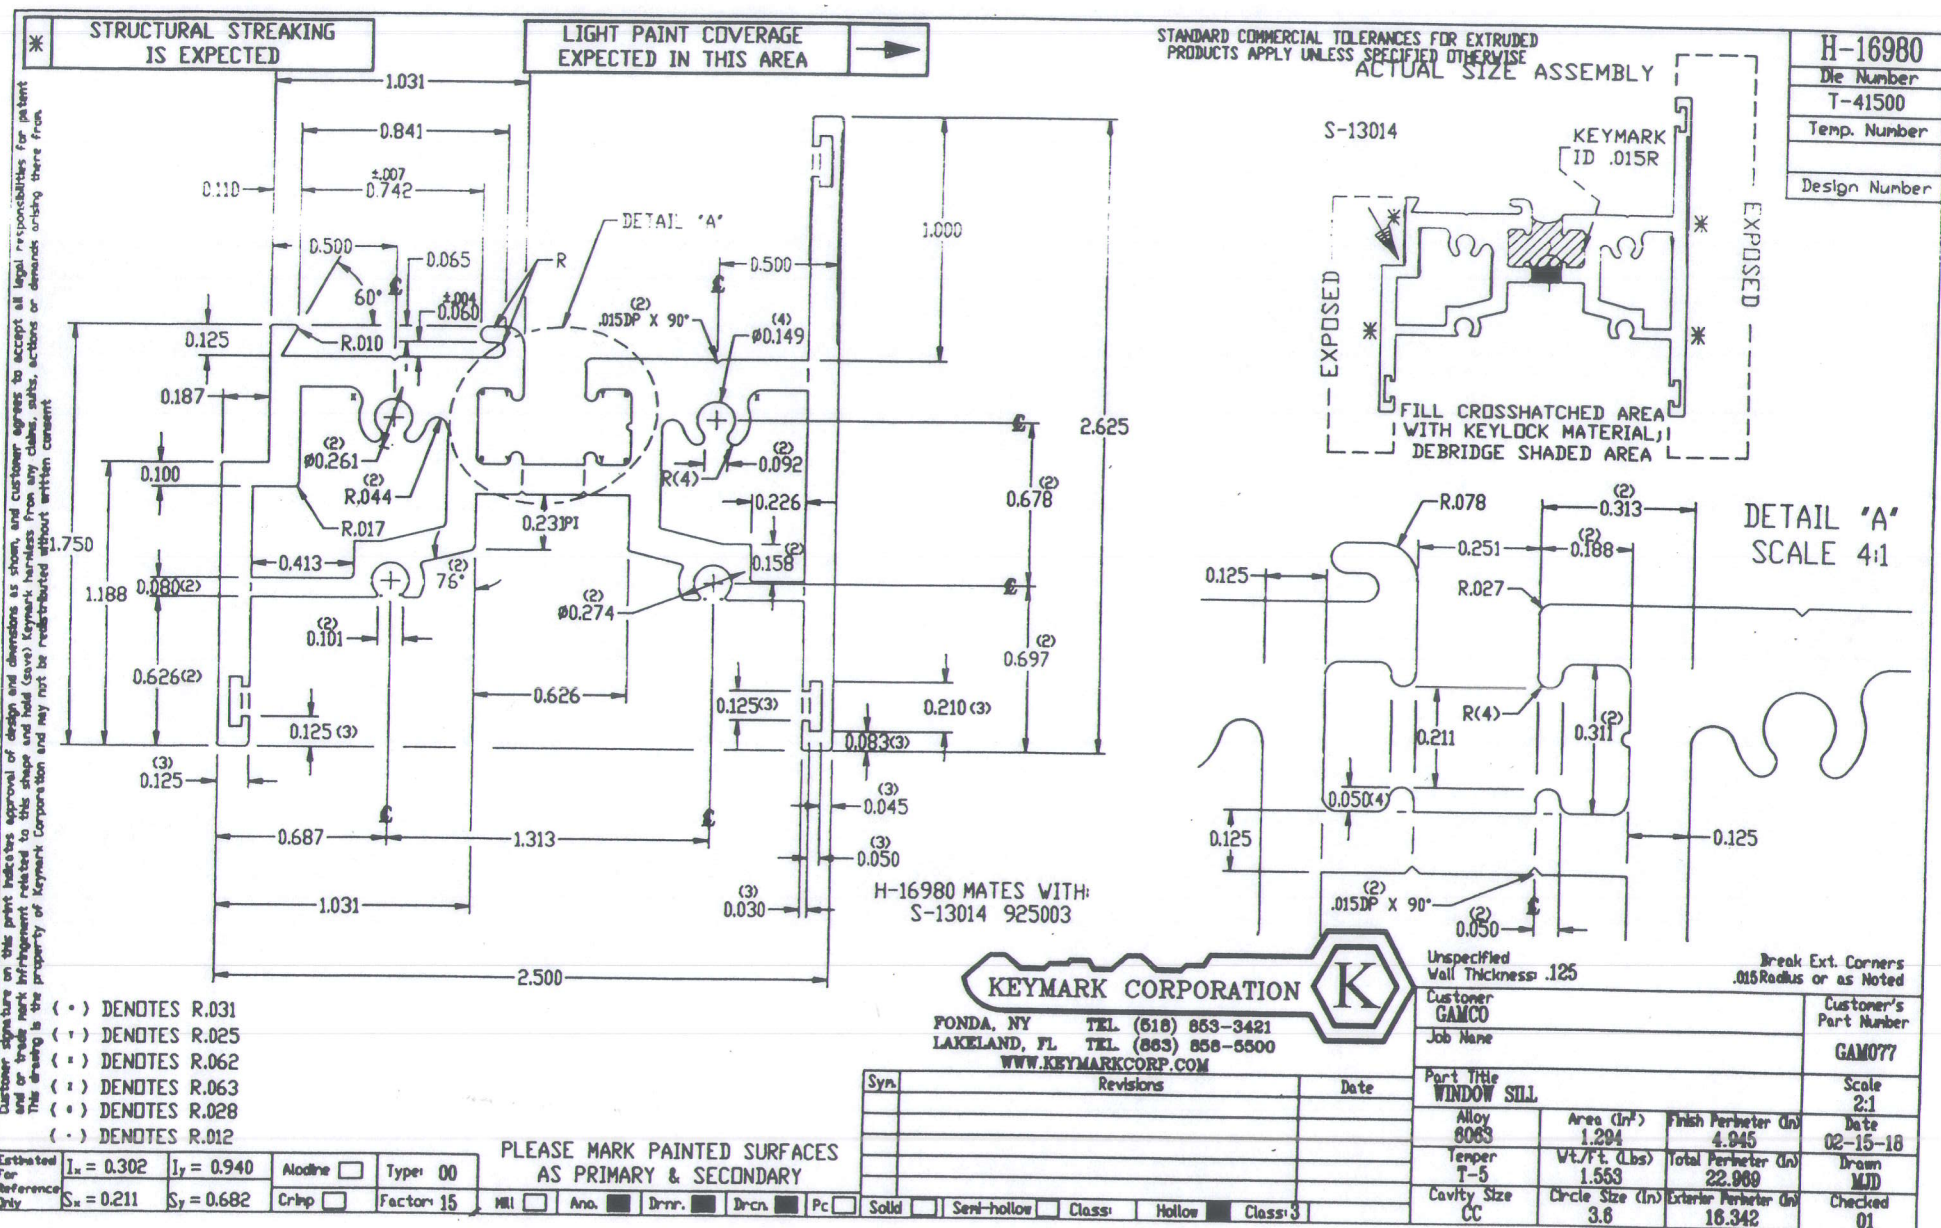

Customer signature on this print indicates approval of design and dimensions as shown, and customer agrees to accept all legal responsibilities for patent and trademark infringement related to this shape and hold Keymark harmless from any claims, suits, actions or demands arising there from. This drawing is the property of Keymark Corporation and may not be redistributed without written consent.

STRUCTURAL STREAKING IS EXPECTED

UNIFORM PAINT COVERAGE NOT EXPECTED IN THIS AREA



STANDARD COMMERCIAL TOLERANCES FOR EXTRUDED PRODUCTS APPLY UNLESS SPECIFIED OTHERWISE

H-02656



Die Number

Temp. Number

Design Number

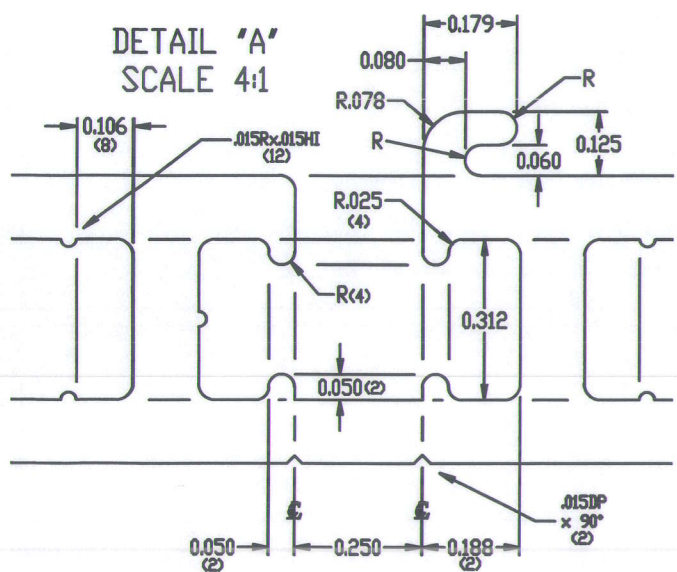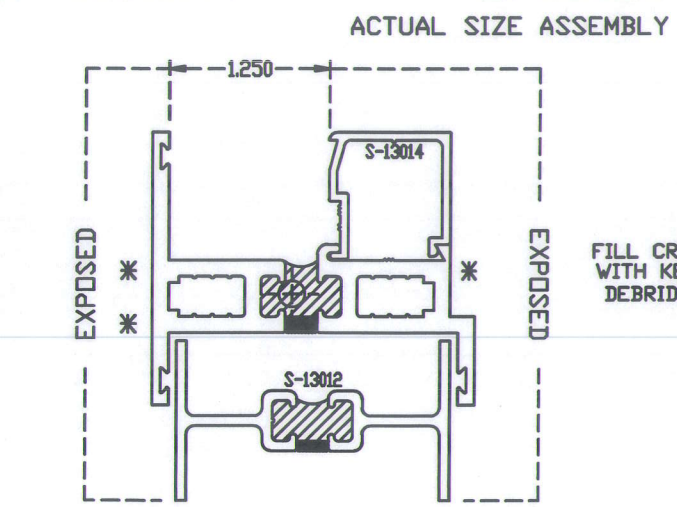

H-02656 MATES WITH:
 S-13011 923001
 S-13012 923004
 S-13014 923003
 S-13023 923009

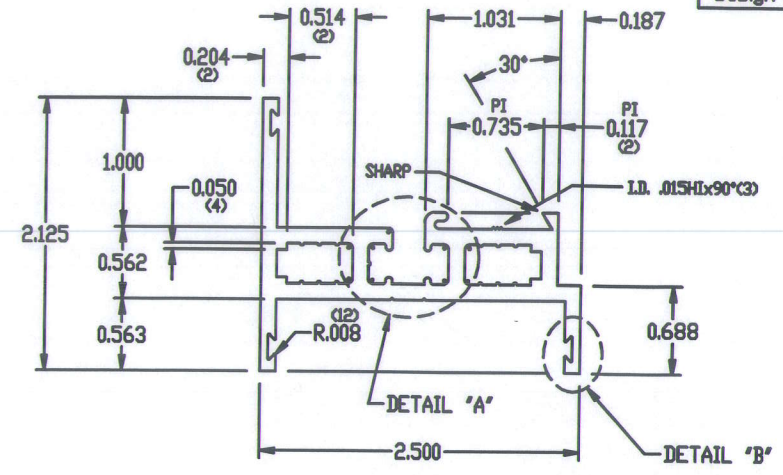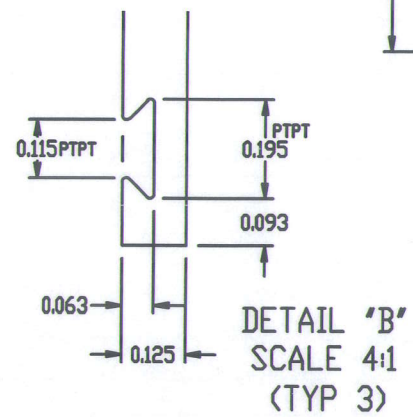

(·) DENOTES R .031 (9)

Molimo
Architectural Product Testing

Report #: 1931.04-106-11

Date: 8/23/2019

By: M. Stremmel

KEYMARK CORPORATION

FONDA, NY TEL. (518) 863-3421
 LAKELAND, FL TEL. (863) 858-5500
 WWW.KEYMARKCORP.COM

Syn	Revisions	Date
6	PRINT REVISION	06-20-16
	MADE .115 AND .195 PT DIMENSIONS (AD)	06-20-16


Customer		Customer's	
KEYMARK CORPORATION		Part Number	
Job Name		930001	
930 PROJECTED WINDOW			
Part Title		Scale	
MAIN FRAME (MALE)		1:1	
Alloy	Area (in ²)	Finish Perimeter (in)	Date
6063	1.020	3.937	08-01-88
Temper	Wt./Ft. (Lbs)	Total Perimeter (in)	Drawn
T-5	1.224	17.434	C.J.T.
Cavity Size	Circle Size (in)	Exterior Perimeter (in)	Checked
CC	3.3	13.660	S.J.S.

Estimated For Reference Only	I _x = 0.148	I _y = 0.738	Alodine <input type="checkbox"/>	Type: 00
	S _x = 0.117	S _y = 0.522	Crimp <input type="checkbox"/>	Factor: 14


MIL <input type="checkbox"/>	Ano. <input type="checkbox"/>	Drnr. <input type="checkbox"/>	Drca. <input type="checkbox"/>	Pc <input type="checkbox"/>	Solid <input type="checkbox"/>	Semi-hollow <input type="checkbox"/>	Class <input type="checkbox"/>	Hollow <input type="checkbox"/>	Class 3 <input type="checkbox"/>	PP <input type="checkbox"/>
------------------------------	-------------------------------	--------------------------------	--------------------------------	-----------------------------	--------------------------------	--------------------------------------	--------------------------------	---------------------------------	----------------------------------	-----------------------------

Molimo™
Architectural Product Testing


Customer signature on this print indicates approval of design and dimensions as shown, and customer agrees to accept all legal responsibilities for patent use or trademark infringement related to this shape and hold (have) Keymark harmless from any claims, suits, actions or demands arising there from. This drawing is the property of Keymark Corporation and may not be redistributed without written consent.

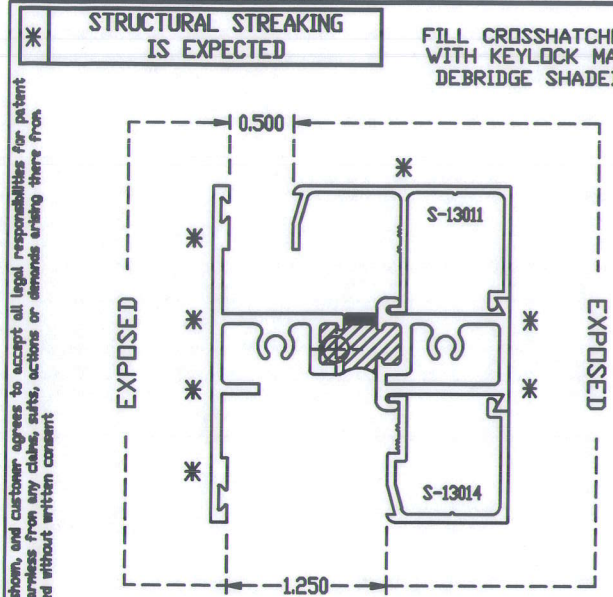

ACTUAL SIZE ASSEMBLY

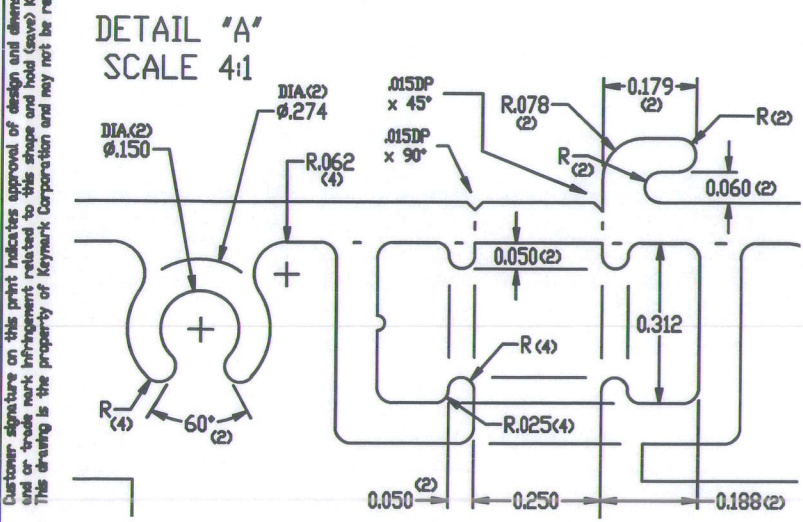


Estimated For Reference Only	$I_x = 0.180$	$I_y = 0.521$	Alodine <input type="checkbox"/>	Type: 00
	$S_x = 0.133$	$S_y = 0.388$	Crimp <input type="checkbox"/>	Factor: 20
			ML <input type="checkbox"/>	Ano. <input type="checkbox"/>
			Dmr. <input type="checkbox"/>	Drcn. <input type="checkbox"/>
			Pc <input type="checkbox"/>	Solid <input type="checkbox"/>
			Semi-hollow <input type="checkbox"/>	Class: <input type="checkbox"/>
			Hollow <input type="checkbox"/>	Class 2 <input type="checkbox"/>
				FP <input type="checkbox"/>

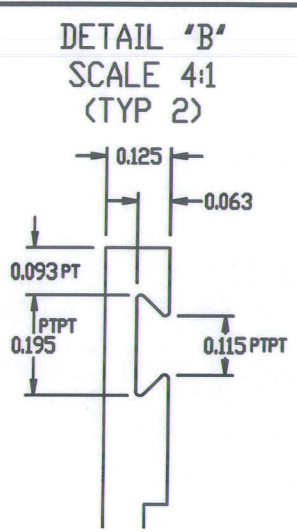


H-02652 MATES WITH:
S-13014 923003
S-13016 923002

STANDARD COMMERCIAL TOLERANCES FOR EXTRUDED PRODUCTS APPLY UNLESS SPECIFIED OTHERWISE

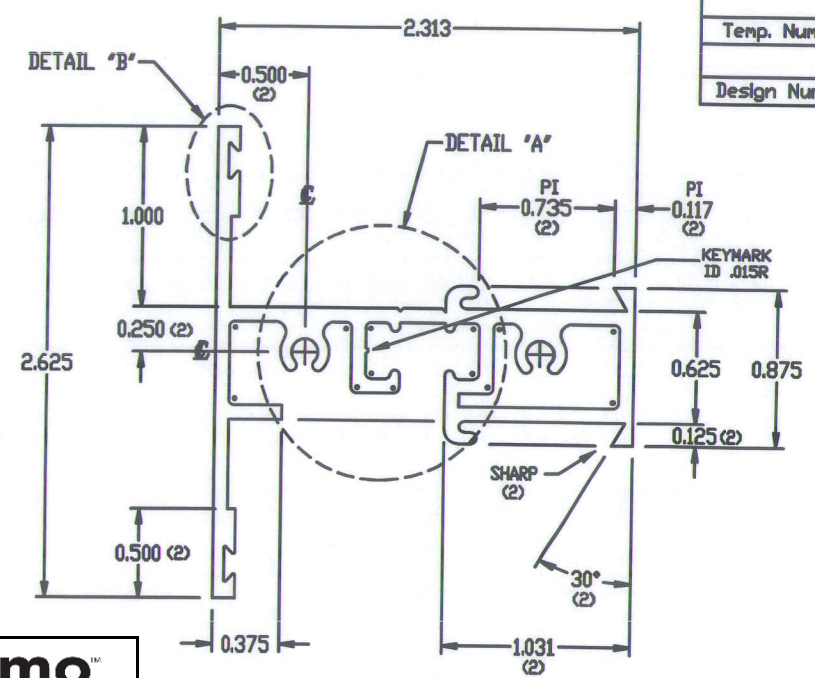

{ } DENOTES R .031 { 13 }


**Molimo™**
Architectural Product Testing

Report #: 1931.04-106-11

Date: 8/23/2019

By: M. Stremmel

KEYMARK CORPORATION
FONDA, NY TEL (518) 863-3421
LAKELAND, FL TEL (863) 858-5500
WWW.KEYMARKCORP.COM



Syn. 5	Revisions	Date	Unspecified Wall Thickness: .080	Break Ext. Corners .015 Radius or as Noted
PRINT REVISION		06-20-18	Customer: KEYMARK CORPORATION	Customer's Part Number: 925007
MADE .115 AND .195 PT DIMENSIONS (AD)		06-20-18	Job Name: 925 PROJECTED WINDOW	Scale: 1:1
			Part Name: MUNTIN BAR	Date: 07-28-88
			Alloy: 6063	Drawn: P.A.S.
			Temper: T-5	Checked: S.J.S.
			Cavity Size: CC	
			Area (in²): 0.808	
			Wt./Ft. (Lbs): 0.970	
			Finish Perimeter (in): 3.750	
			Total Perimeter (in): 19.621	
			Circle Size (in): 3.1	
			Exterior Perimeter (in): 16.165	

Customer signature on this print indicates approval of design and dimensions as shown, and customer agrees to accept all legal responsibilities for patent and or trade mark infringement related to this shape and hold (give) Keymark harmless from any claims, suits, actions or demands arising there from. This drawing is the property of Keymark Corporation and may not be redistributed without written consent.

STRUCTURAL STREAKING
IS EXPECTED

ACTUAL SIZE

UNIFORM PAINT COVERAGE
NOT EXPECTED IN THIS AREA


STANDARD COMMERCIAL TOLERANCES FOR EXTRUDED
PRODUCTS APPLY UNLESS SPECIFIED OTHERWISE

S-13014

Die Number

Temp. Number

Design Number





REFER FOR ASSEMBLY TO H-02650

FOR ASSEMBLY
REFER TO T-42016

MATES WITH:
H-02649 925001
H-02650 925006
H-02651 925005
H-02652 925007
H-02653 925003
H-02654 925004
H-02655 925002
T-42016

DETAIL 'A'
SCALE 8:1

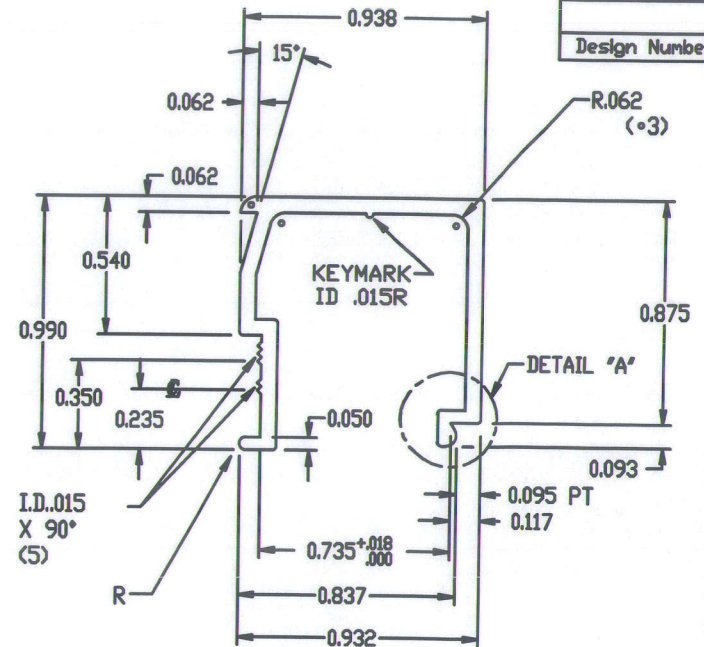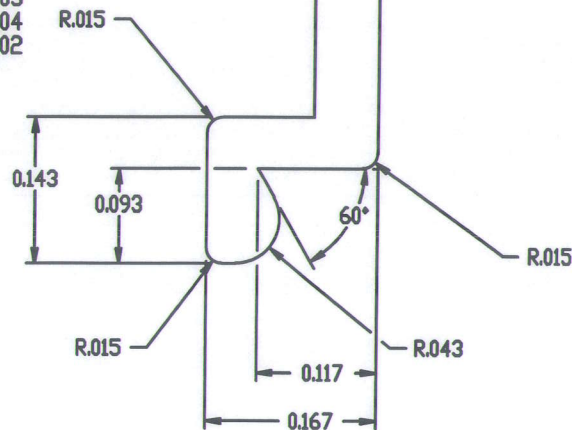

Molimo™
Architectural Product Testing

Report #: 1931.04-106-11

Date: 8/23/2019

By: M. Stremmel

KEYMARK CORPORATION

FONDA, NY TEL (618) 853-3421
LAKELAND, FL TEL (863) 858-5500
WWW.KEYMARKCORP.COM



Unspecified
Wall Thickness: .062

Break Ext. Corners
.015 Radius or as Noted

Customer
KEYMARK CORPORATION

Customer's
Part Number

Job Name
925/930 PROJECTED WINDOW

925003

Part Title
GLAZING BEAD FOR 1" GLASS

Scale
2:1

Alloy
6063

Area (in²)
0.188

Finish Perimeter (in)
1.851

Date
07-08-88

Temper
T-5

Vt./Ft. (Lbs)
0.228

Total Perimeter (in)
6.179

Drawn
F.A.S.

Cavity Size

Circle Size (in)
1.3

Exterior Perimeter (in)
6.179

Checked
S.J.S. 05

Estimated For Reference Only	I _x = 0.020	I _y = 0.026	Modline <input type="checkbox"/>	Type: 00
	S _x = 0.033	S _y = 0.055	Crimp <input type="checkbox"/>	Factor: 27

MIL ☐ Ano. ☒ Drnr. ☒ Drcn. ☒ Pc ☐ Solid ☒ Semi-hollow ☐ Class ☐ Hollow ☐ Class ☐

Customer signature on this print indicates approval of design and dimensions as shown, and customer agrees to accept all legal responsibilities for patent and or trade mark infringement related to this shape and hold (leave) Keymark harmless from any claims, suits, actions or demands arising there from. This drawing is the property of Keymark Corporation and may not be redistributed without written consent

✱

STRUCTURAL STREAKING
IS EXPECTED


STANDARD COMMERCIAL TOLERANCES FOR EXTRUDED
PRODUCTS APPLY UNLESS SPECIFIED OTHERWISE

S-13020

Die Number

Temp. Number

Design Number

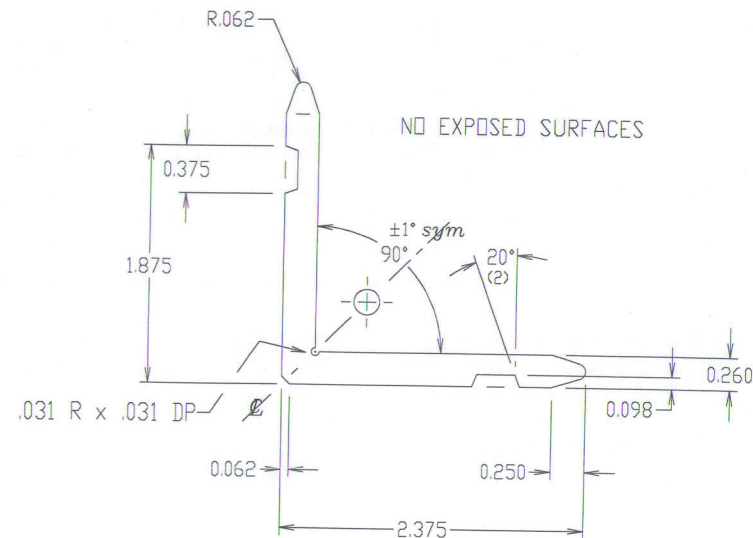

Molimo™
Architectural Product Testing

Report #: 1931.04-106-11

Date: 8/23/2019

By: M. Stremmel

KEYMARK CORPORATION
FONDA, NEW YORK
FAX ENG.(518)853-3435 SALES(518)853-3130
TEL. (518) 853-3421 E-MAIL engny@keymarkcorp.com



Unspecified
Wall Thickness: .260

.015 Break Ext. Corners
Radius or as Noted

Customer
KEYMARK CORPORATION

Customer's
Part Number

Job Name
915/922/923/925/930 PROJECTED WINDOW

925000

Part Title
CORNER KEY

Scale
1:1

Alloy
6105

Est. Area
1.052 In²

Finish Perimeter
0.000 In

Date
07-28-88

Temper
T-5

Est. Wt./Ft.
1.262 Lbs

Est. Perimeter
9.490 In

Drawn
F.A.S.

Cavity Size

Circle Size
3.2 In

Exterior Perimeter
9.490 In

Checked
S.J.S. 03

Sym.	Revisions	Date

Estimated For Reference Only	I _x = 0.505	I _y = 0.505	Alodine <input type="checkbox"/>	Type: 00
	S _x = 0.294	S _y = 0.294	Crimp	Factor 8

MILL ☒ Ano. ☐ Drnr. ☐ Drcn. ☐ Pc ☐ Solid ☒ Semi-hollow ☐ Class ☐ Hollow ☐ Class ☐